


Meerut (Kali, tributary of Ganga)

150,000

68

The filthy stem

Not one of the monitoring stations on the banks of the Ganga from Uttar Pradesh to West Bengal found water quality that is fit for drinking as per the standards set by CPCB

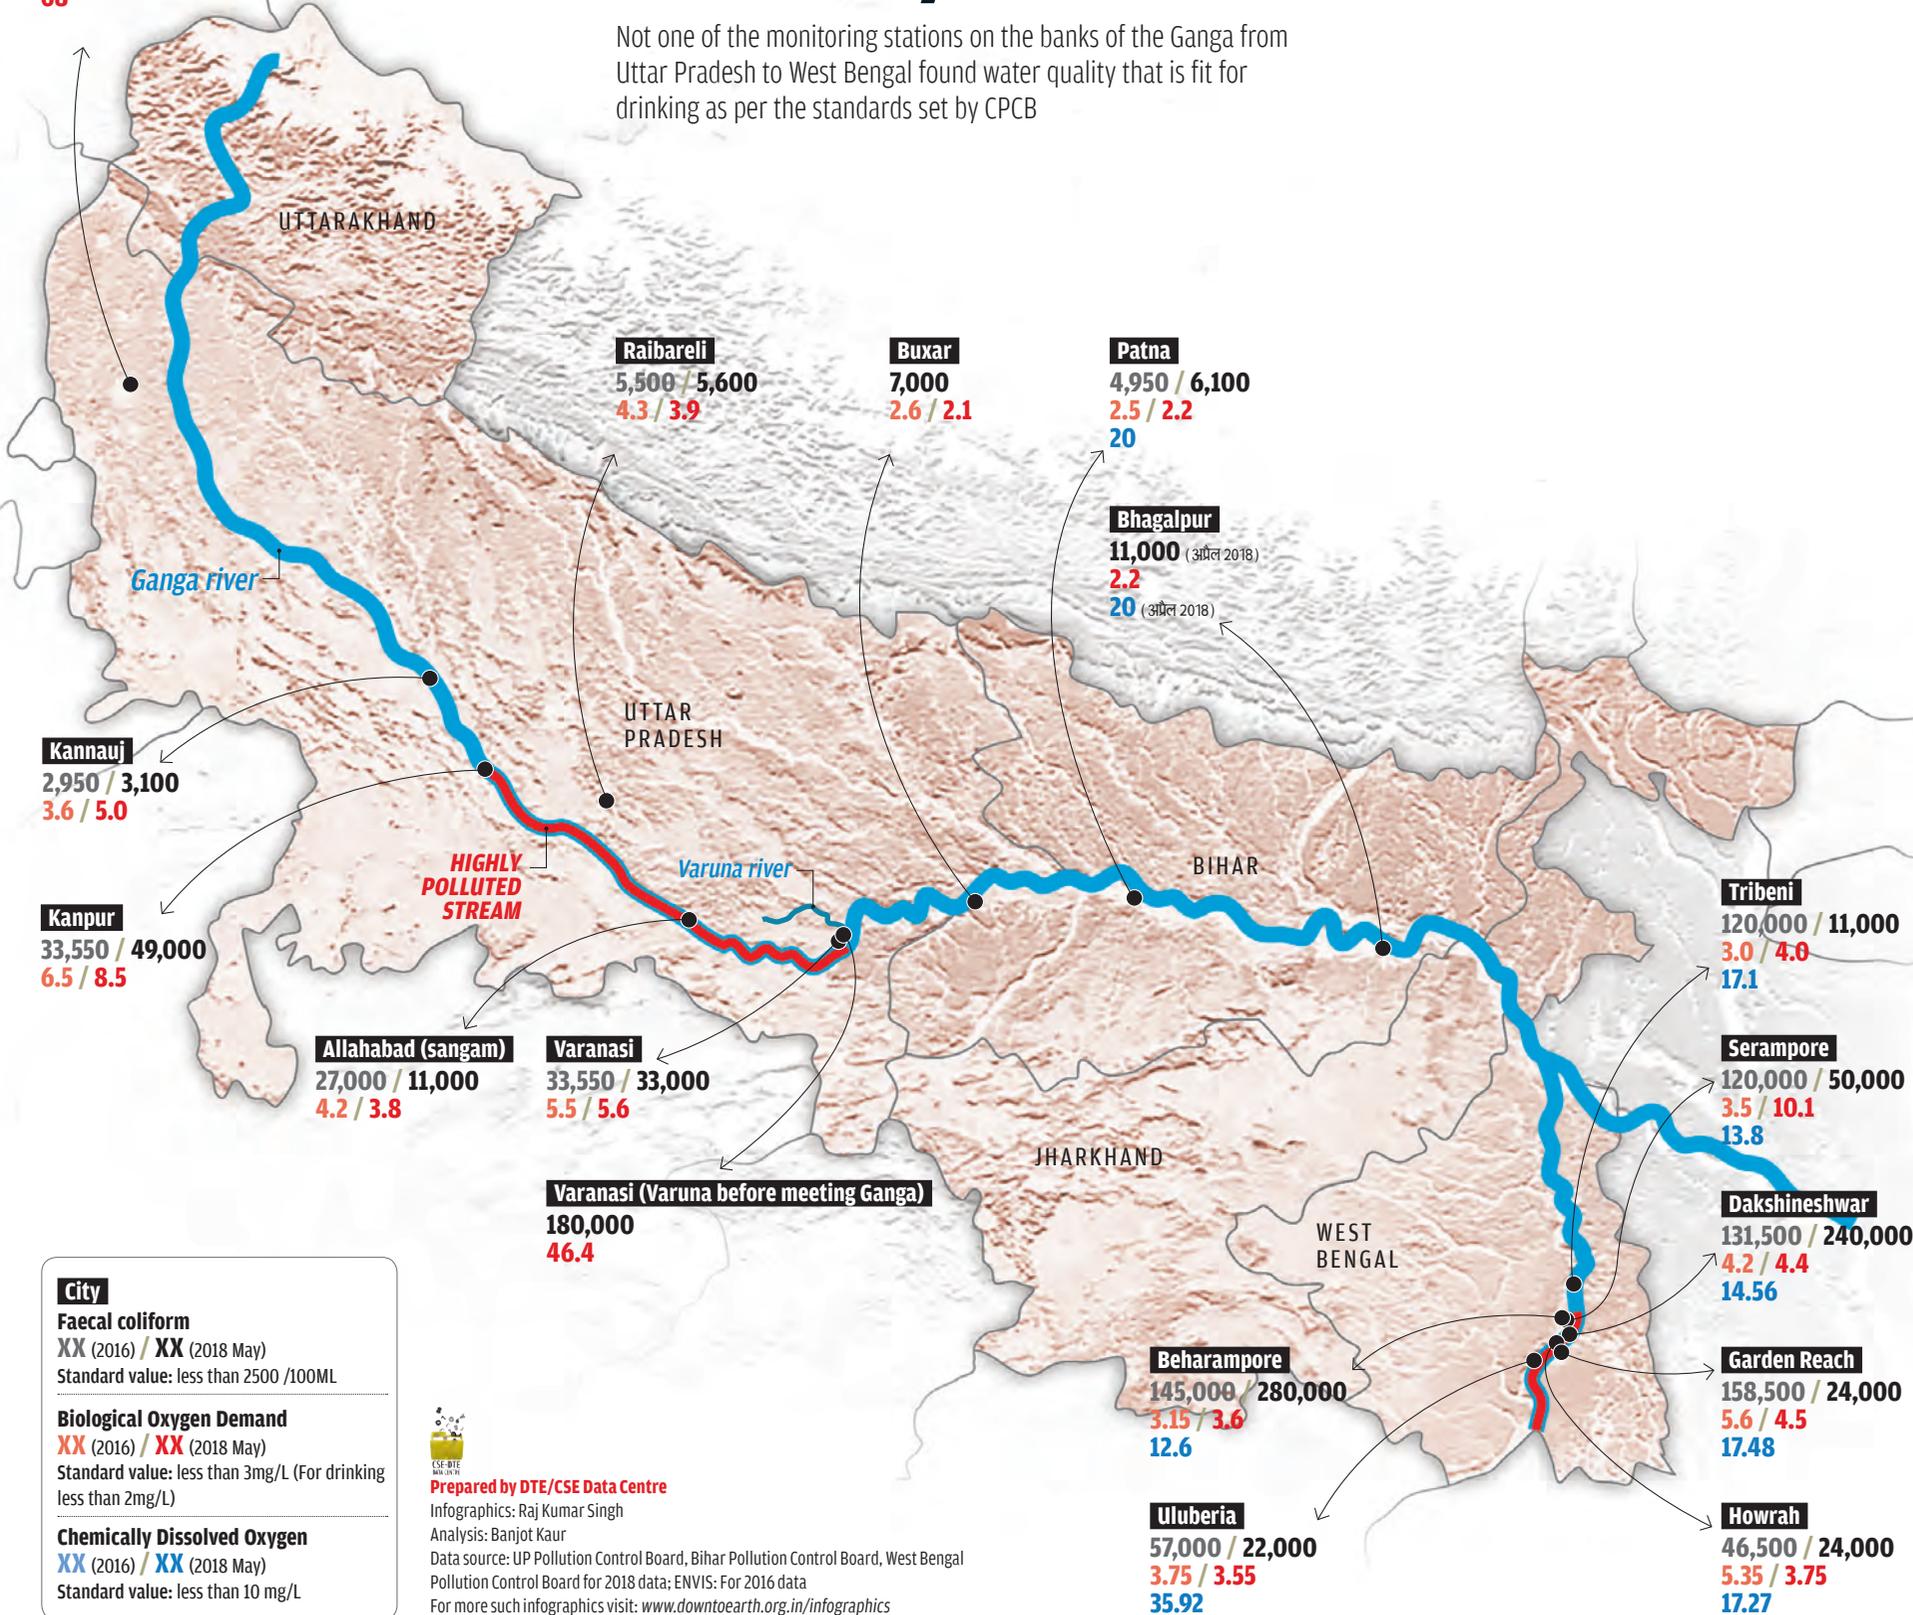

City

Faecal coliform
XX (2016) / XX (2018 May)
Standard value: less than 2500 /100ML

Biological Oxygen Demand
XX (2016) / XX (2018 May)
Standard value: less than 3mg/L (For drinking less than 2mg/L)

Chemically Dissolved Oxygen
XX (2016) / XX (2018 May)
Standard value: less than 10 mg/L



Prepared by DTE/CSE Data Centre
 Infographics: Raj Kumar Singh
 Analysis: Banjot Kaur
 Data source: UP Pollution Control Board, Bihar Pollution Control Board, West Bengal Pollution Control Board for 2018 data; ENVIS: For 2016 data
 For more such infographics visit: www.downtoearth.org.in/infographics